

INZYKT-W-004-01



0371-83659611

环境检测报告

TEST REPORT

报告编号: ZYCY-2023-0531

委托单位: 河南联产项目

委托日期: 2023年05月25日



检测地点:

河南省郑州市金水区农业路111号A座11楼1101室

检测项目: 室内空气环境检测

检测地址: 河南省郑州市金水区农业路111号A座11楼1101室

检测日期: 2023年05月25日

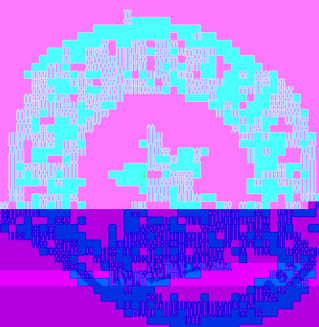

检测单位: 郑州联产项目

检测日期: 2023年05月25日

公司地址: www.zycy.com

地址: 河南省郑州市金水区农业路111号A座11楼1101室 电话: 0371-83659611 邮编: 450000



用作商业推广用途的。本公司将依法追索甘姓损失。



一 其十六白

$\alpha_{\text{max}} = 0.6$	最大値は、 $\alpha = 0.6$ のとき
$\beta_{\text{max}} = \frac{\pi}{2}$	最大値は、 $\beta = \frac{\pi}{2}$ のとき

检测点位	检测项目	检测数据	检测结论
釜、尾气排放	4.30天 检测	无超标废气	达标排放

15. 2008年10月1日起，增值税一般纳税人购进国内货物发生退货，其进项税额能否从销项税额中抵扣？

- 1、听整段录音并做快速略读，做题；
- 2、听读用表格记录关键信息并做快速略读，边听边做题；
- 3、听读用表格记录关键信息并做快速略读，边听边做题；
- 4、听读用表格记录关键信息并做快速略读，边听边做题；

- 2017年12月15日，中国银保监会发布《商业银行资本管理办法（征求意见稿）》，对商业银行资本充足率监管要求进行了修订。

1998, 1999, 2000, 2001, 2002, 2003, 2004, 2005, 2006, 2007, 2008, 2009, 2010, 2011, 2012, 2013, 2014, 2015, 2016, 2017, 2018, 2019, 2020, 2021, 2022, 2023, 2024, 2025, 2026, 2027, 2028, 2029, 2030, 2031, 2032, 2033, 2034, 2035, 2036, 2037, 2038, 2039, 2040, 2041, 2042, 2043, 2044, 2045, 2046, 2047, 2048, 2049, 2050, 2051, 2052, 2053, 2054, 2055, 2056, 2057, 2058, 2059, 2060, 2061, 2062, 2063, 2064, 2065, 2066, 2067, 2068, 2069, 2070, 2071, 2072, 2073, 2074, 2075, 2076, 2077, 2078, 2079, 2080, 2081, 2082, 2083, 2084, 2085, 2086, 2087, 2088, 2089, 2090, 2091, 2092, 2093, 2094, 2095, 2096, 2097, 2098, 2099, 2100, 2101, 2102, 2103, 2104, 2105, 2106, 2107, 2108, 2109, 2110, 2111, 2112, 2113, 2114, 2115, 2116, 2117, 2118, 2119, 2120, 2121, 2122, 2123, 2124, 2125, 2126, 2127, 2128, 2129, 2130, 2131, 2132, 2133, 2134, 2135, 2136, 2137, 2138, 2139, 2140, 2141, 2142, 2143, 2144, 2145, 2146, 2147, 2148, 2149, 2150, 2151, 2152, 2153, 2154, 2155, 2156, 2157, 2158, 2159, 2160, 2161, 2162, 2163, 2164, 2165, 2166, 2167, 2168, 2169, 2170, 2171, 2172, 2173, 2174, 2175, 2176, 2177, 2178, 2179, 2180, 2181, 2182, 2183, 2184, 2185, 2186, 2187, 2188, 2189, 2190, 2191, 2192, 2193, 2194, 2195, 2196, 2197, 2198, 2199, 2200, 2201, 2202, 2203, 2204, 2205, 2206, 2207, 2208, 2209, 2210, 2211, 2212, 2213, 2214, 2215, 2216, 2217, 2218, 2219, 2220, 2221, 2222, 2223, 2224, 2225, 2226, 2227, 2228, 2229, 2230, 2231, 2232, 2233, 2234, 2235, 2236, 2237, 2238, 2239, 2240, 2241, 2242, 2243, 2244, 2245, 2246, 2247, 2248, 2249, 2250, 2251, 2252, 2253, 2254, 2255, 2256, 2257, 2258, 2259, 2260, 2261, 2262, 2263, 2264, 2265, 2266, 2267, 2268, 2269, 2270, 2271, 2272, 2273, 2274, 2275, 2276, 2277, 2278, 2279, 2280, 2281, 2282, 2283, 2284, 2285, 2286, 2287, 2288, 2289, 2290, 2291, 2292, 2293, 2294, 2295, 2296, 2297, 2298, 2299, 2300, 2301, 2302, 2303, 2304, 2305, 2306, 2307, 2308, 2309, 2310, 2311, 2312, 2313, 2314, 2315, 2316, 2317, 2318, 2319, 2320, 2321, 2322, 2323, 2324, 2325, 2326, 2327, 2328, 2329, 2330, 2331, 2332, 2333, 2334, 2335, 2336, 2337, 2338, 2339, 2340, 2341, 2342, 2343, 2344, 2345, 2346, 2347, 2348, 2349, 2350, 2351, 2352, 2353, 2354, 2355, 2356, 2357, 2358, 2359, 2360, 2361, 2362, 2363, 2364, 2365, 2366, 2367, 2368, 2369, 2370, 2371, 2372, 2373, 2374, 2375, 2376, 2377, 2378, 2379, 2380, 2381, 2382, 2383, 2384, 2385, 2386, 2387, 2388, 2389, 2390, 2391, 2392, 2393, 2394, 2395, 2396, 2397, 2398, 2399, 2400, 2401, 2402, 2403, 2404, 2405, 2406, 2407, 2408, 2409, 2410, 2411, 2412, 2413, 2414, 2415, 2416, 2417, 2418, 2419, 2420, 2421, 2422, 2423, 2424, 2425, 2426, 2427, 2428, 2429, 2430, 2431, 2432, 2433, 2434, 2435, 2436, 2437, 2438, 2439, 2440, 2441, 2442, 2443, 2444, 2445, 2446, 2447, 2448, 2449, 2450, 2451, 2452, 2453, 2454, 2455, 2456, 2457, 2458, 2459, 2460, 2461, 2462, 2463, 2464, 2465, 2466, 2467, 2468, 2469, 2470, 2471, 2472, 2473, 2474, 2475, 2476, 2477, 2478, 2479, 2480, 2481, 2482, 2483, 2484, 2485, 2486, 2487, 2488, 2489, 2490, 2491, 2492, 2493, 2494, 2495, 2496, 2497, 2498, 2499, 2500, 2501, 2502, 2503, 2504, 2505, 2506, 2507, 2508, 2509, 2510, 2511, 2512, 2513, 2514, 2515, 2516, 2517, 2518, 2519, 2520, 2521, 2522, 2523, 2524, 2525, 2526, 2527, 2528, 2529, 2530, 2531, 2532, 2533, 2534, 2535, 2536, 2537, 2538, 2539, 2540, 2541, 2542, 2543, 2544, 2545, 2546, 2547, 2548, 2549, 2550, 2551, 2552, 2553, 2554, 2555, 2556, 2557, 2558, 2559, 2560, 2561, 2562, 2563, 2564, 2565, 2566, 2567, 2568, 2569, 2570, 2571, 2572, 2573, 2574, 2575, 2576, 2577, 2578, 2579, 2580, 2581, 2582, 2583, 2584, 2585, 2586, 2587, 2588, 2589, 2590, 2591, 2592, 2593, 2594, 2595, 2596, 2597, 2598, 2599, 2600, 2601, 2602, 2603, 2604, 2605, 2606, 2607, 2608, 2609, 2610, 2611, 2612, 2613, 2614, 2615, 2616, 2617, 2618, 2619, 2620, 2621, 2622, 2623, 2624, 2625, 2626, 2627, 2628, 2629, 2630, 2631, 2632, 2633, 2634, 2635, 2636, 2637, 2638, 2639, 2640, 2641, 2642, 2643, 2644, 2645, 2646, 2647, 2648, 2649, 2650, 2651, 2652, 2653, 2654, 2655, 2656, 2657, 2658, 2659, 2660, 2661, 2662, 2663, 2664, 2665, 2666, 2667, 2668, 2669, 2670, 2671, 2672, 2673, 2674, 2675, 2676, 2677, 2678, 2679, 26

[illegible]

五、检测站事
(1) 无站阻害管

样品编号	样品状态	检测点位	检测项目
WZ23033101(01-04)-03	完好	上风向 1#	硫化氢
WZ23033101(01-04)-02	完好		氨
WZ23033101(01-04)-01	完好		臭气浓度
WZ23033101(01-04)-04	完好		非甲烷总烃
WZ23033101(01-04)-05	完好		非甲烷总烃
WZ23033102(01-04)-03	完好	下风向 2#	硫化氢
WZ23033102(01-04)-02	完好		氨
WZ23033102(01-04)-01	完好		臭气浓度
WZ23033102(01-04)-04	完好		非甲烷总烃
WZ23033102(01-04)-05	完好		非甲烷总烃
WZ23033103(01-04)-01	完好		氨
WZ23033103(01-04)-02	完好		氨
WZ23033103(01-04)-01	完好	下风向 3#	臭气浓度
WZ23033103(01-04)-04	完好		臭气浓度
WZ23033103(01-04)-03	完好		非甲烷总烃
WZ23033104(01-04)-03	完好		硫化氢
WZ23033104(01-04)-01	完好	下风向 4#	臭气浓度
WZ23033104(01-04)-02	完好		臭气浓度
WZ23033104(01-04)-03	完好		臭气浓度

13:08-14:14	0.002	3738
14:14-15:21	0.002	
15:21-16:03	0.002	
11:08-12:08	0.06	15
13:14-14:14	0.08	
14:20-15:26	0.08	

恒 测 报 告

续上表

[illegible]

13:14-14:14	0.258	2.0	mg/m ³	非甲烷总烃
15:20-16:20	0.253		mg/m ³	
09:03-10:03	0.50		mg/m ³	
11:08-12:08	0.51		mg/m ³	
13:14-14:14	0.49		mg/m ³	

09:03-10:03	0.006	7.006	0.006	0.006	0.006
11:00-12:00	0.006		0.006		
13:14-14:14	0.006		0.006		
15:22-16:22	0.006		0.006		
09:03-10:03	0.006	7.006	0.006	0.006	0.006
11:00-12:00	0.006		0.006		

13-14-14-14	0.11	20	mg/m ³	30~5000	0.10
15-20-16-20	0.09		mg/m ³		
20-10-03 (30%补料)	<10		50~100		
05-12-05 (20%补料, 1.2)	<10		50~100		
13-14-14-14 (10%补料, 1.5)	<10		50~100		
03-01-03 (20%补料)	<10		50~100		


检测预报

续上表

采样点名称		采样时间	采样浓度	采样流量	采样体积
下风向 4#	顺道南	13:13-14:07	0.253	1.0	mg/m^3
		13:14-14:14	0.253		mg/m^3
		15:20-16:20	0.253		mg/m^3
	非甲类固废	08:03-08:08	0.51		mg/m^3
		11:50-12:08	0.46	2.0	mg/m^3
		13:14-14:14	0.49		mg/m^3
		15:20-16:20	0.45		mg/m^3

[illegible]

附贈：項目評語與標準表格與填寫說明

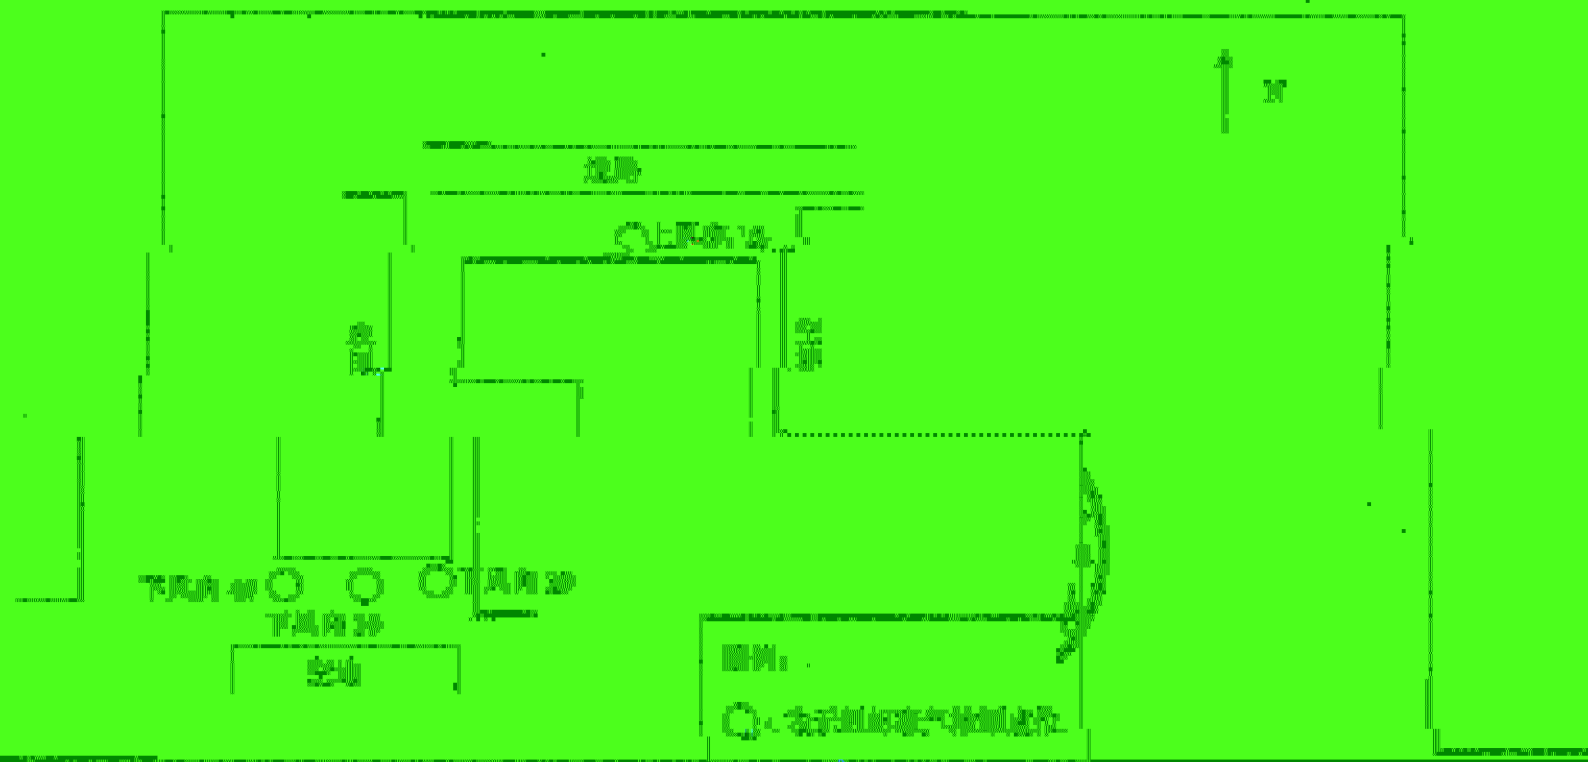

北京

The figure consists of two parts. The top part is a schematic of a two-dimensional lattice, represented by a grid of squares. A central square is highlighted in black. The bottom part is a similar schematic, but with a small square labeled 'a' indicating the lattice constant.